#### Prüfinstitut Hoch

Lerchenweg 1 D-97650 Fladungen Tel.: int – 49 – 9778-7480-200

Tel.: int – 49 – 9778-7480-200 hoch.fladungen@t-online.de

www.reaction-to-fire.de



Test laboratory for the fire behavior of building materials, Dipl.-Ing. (FH) Andreas Hoch Testing, supervising and certifying body, authorized by the building supervision authority

# TEST REPORT PZ-Hoch-170149

for the proof of fire behaviour according to DIN 4102, part 1

Translation of the German test report - no guarantee for translation of technical terms

company

**Texo Trade Services BV** 

Coenecoop 640

2741 PV Waddinxveen

description of samples

white knitted polyester

-fabric 1: area weight about 126 g/m<sup>2</sup> -fabric 2: area weight about 337 g/m<sup>2</sup>

name of the material

"Display Stretch 220 FR "

sampling

by the company itself

content of request

Proof of flammability to classify building materials to class B1

("schwerentflammbar") according to DIN 4102, part 1

validity of test report

31.01.2022

result

The examined product meets

• with an area weight range of 126 g/m² until 337 g/m²

suspended freely or with distance of >40 mm to same or

other plain materials

the requirements of class B1 for hardly flammable ("schwerentflammbare") building materials according to

DIN 4102, pt. 1 (May 1998).

This test report includes 5 pages and 6 enclosures.

Remark: If the building material mentioned above is not used as a product according to MBO § 2, Abs. 9, Ziffer1, there is no need for a general building supervisory test report.

This test report is not valid if the examined building material is used as product as defined by State Building Prescriptions (MBO § 17, Abs. 3).

This test report does not replace an eventually necessary proof of applicability concerning building supervisory or building laws as defined by State Building Prescriptions. This has to be certified instead by:

"allgemeine bauaufsichtliche Zulassung" (General Building Inspectorate Approval ) or by "allgemeines bauaufsichtliches Prüfzeugnis" (General Building Inspectorate Certificate) or by

- "Zustimmung im Einzelfall" (Exceptional Approval)

This test report can underlie building supervisory procedures

for regular building products for the prescribed proofs of conformity

for irregular building products for the required proofs of applicability.

Without written consent of the test laboratory, this test report may only be published or duplicated during its denoted period of validity, providing that no changes to appearance or content are made.

page 2 of 5 of the test report PZ-Hoch-170149

#### 1. Description of test material in condition as delivered

PN 24815 "Display Stretch 220 FR"

-light fabric-

-white knitted fabricside A: glossier

characteristic values determined by the test laboratory:

area weight: about 126 g/m²

thickness: about 0,29 mm

PN 24816 ,, Display Stretch 220 FR "

-heavy fabric-

-white knitted fabric-Side B: smoother

characteristic values determined by the test laboratory:

area weight: about 337 g/m<sup>2</sup>

thickness: about 0,60 mm

The testing laboratory is not provided with further details concerning composition of the tested building materials. Samples are deposited.

#### 2. Preparation of samples

Samples with a size of 1000 mm height and 190 mm width where cut from the material for fire testing.

The samples were kept in climate chamber 23/50 until they reached constant weight.

#### 3. Arrangement of samples

mounting: freely suspended

#8728: PN 24816 flaming side A in warp direction

#8729: PN 24816 flaming side B in warp direction

#8730: PN 24816 flaming side A in weft direction

#8731: PN 24815 flaming side B in warp direction

-heavy fabric-heavy fabric-light fabric-

#### 4. Date of test CW 06 in 2017

page 3 of 5 of the test report PZ-Hoch-170149

### 5. Results The test has been performed according to DIN 4102 (Mai 1998)

	Measurement	Resu	It with the t	ested spec	cimen	Dim.
00	Test number	#8728	#8729	#8730	#8731	
line	flaming direction	warp	warp	weft	warp	
=	side	Α	В	Α	В	
	Heavy / light fabric		heavy		light	
1	Number of specimen arrangement acc. to. DIN 4102/T15, schedule 1	1	1	1	1	
2 3	Maximum flame height above bottom edge of specimen Time 1)	<b>40</b> 0:05	30 0:02	<b>40</b> 0:19	30 0:02	cm min:s
4	Burn-through / melting Time 1)	0:04	0:04	0:04	0:02	min:s
5	Observations on the back side of specimen Flames / Glowing Time <sup>1)</sup> Change of colour Time <sup>1)</sup>	.J. .J. .J. .J.	.J. .J. .J. .J.	./. ./. ./. ./.	.I. .I. .I. .I.	min:s
7 8	Falling of burning droplets Start 1) Extent sporadic falling of burning droplets 2)	.J. .J.	J.	.I. .I.	.J.	min:s
9	continuous falling of burning droplets 2)	.1.	.1.	./.	./.	min:s
10	Falling of burning parts Start 1) Extent	.J. .J.	J.	./. ./.	J.	min:s
11 12	sporadic falling of burning parts <sup>2)</sup> continuous falling of burning parts <sup>2)</sup>	.1.	./.	.1.	.1.	
13	Burning duration at sieve plate (max.)	./.	J.	./.	./	min:s
14	Impairment of burner by dropping or falling material: Time 1)	.I.	J.	./.	J.	min:s
15	Premature end of test Final occurrence of burning at the specimen 1)	./.	.I.	./.	.J.	min:s
16	Time of eventually end of test 1)	./.	./.	./.	.1.	min:s
17 18 19	Afterburning after end of test Time 1) Number of specimen Front side of specimen 2)	J. J. J.	.J. .J. .J.	.J. .J. .J.	.J. .J. .J.	min:s
20	Rear side of specimen <sup>2)</sup> flame length	./. ./.	./. ./.	./. ./.	.J. .J.	cm

Lerchenweg 1 D-97650 Fladungen

	Measurement	Result with the tested specimen							
0	Test number	#8728	#8729	#8730	#8731				
line	flaming direction	warp	warp	weft	warp				
≔	side	Α	В	Α	В				
-	Heavy / light fabric		heavy		light				
	Afterglow after end of test	J.	.1.	./.	./.				
22	Time 1)	./.	.1.	./.	./.	min:s			
23	Number of specimen	./.	./.	./.	./.				
	Place of appearance	./.	./.	./.	./.				
24	Lower half of the specimen 2)	./.	./.	./.	.J.				
25	Upper half of the specimen 2)	./.	.1,	./.	./.				
26	Front side of specimen 2)	./.	./.	./,	./.				
27	Rear side of specimen 2)	./.	./.	./.	./.				
	Density of smoke								
28	≤ 400 % * min	1	1	1	1	% * mir			
29	> 400 % * min <sup>4)</sup>	./.	./.	./.	./.	% * mir			
30	Diagram in enclosure no.	1	2	3	4				
	Residual lengths: individual values3)								
	Specimen 1	72	72	70	71	cm			
31	Specimen 2	65	69	72	. 70	cm			
	Specimen 3	69	75	66	68	cm			
	Specimen 4	67	73	71	73	cm			
32	Average residual length <sup>3)</sup>	68	72	70	71				
33	Photo of specimen in enclosure no.	11	2	3	4				
34	Flue gas temperature								
(E)	Maximum of average values	123	117	122	118	°C			
35	Time 1)	9:54	09:58	09:48	09:57	min:s			
36	Diagram in enclosure no.	1	2	3	4				

<sup>37</sup> Remarks: - none indication of times relative to beginning of test

checked if applicable
indication of carrier/foam layer separated in case of fire-proofing agents
very strong development of smoke

#### 6. Explanations concerning the testing procedure

-none-

#### 7. Summary of results and additional establishments to Fire Behaviour

	Measurement	Result with the tested specimen									
lineno		#8728 warp side A	#8729 warp side B	#8730 weft side A	#8731 warp side B	dimension					
	heavy / light fabric		heavy	y light							
1	residual length	68	72	70	71	cm					
2	max. smoke temperature	123	117	122	118	°C					
3	integral of smoke density	1	1	1	1	%min					
4	remarks: none										

According to DIN 4102, pt. 1, hardly flammable ("schwerentflammbare") building materials must meet the requirements of class B2.

After performing additional tests in the ignitability apparatus, this could be verified (encl. 5 & 6).

#### 8. Special remarks

- This report is only valid for the material as described in paragraph 1. In combination with other materials or with additional coatings or primers etc., the burning behaviour may differ.
- This test report is not valid for the exposure to outdoor climate conditions, washing or cleaning with chemicals.
- This test report is not valid if the material is used as a building product in the sense of the State Building Regulations ("Landesbauordnungen", MBO § 17, par. 3).
- This test report is no substitute for a General Building Inspectorate Certificate.
- This test report is granted without prejudice to the rights of third parties, in particular private proprietary rights.
- For legal interests, only the German original version is relevant.
- In General Building Inspectorates procedures, this test report can be used for
  - regular building materials for the required proof of accordance
  - for not regular building materials for the required proof of applicability

#### 9. Validity

This test report is valid until the denoted date on page 1. The test report becomes invalid in case the standards on which these tests are based are changed.


Fladungen, 08.02.2017

Clerk in charge:


(Dipl.-Ing. (FH) Jürgen Hammer)


Head of test laboratory:

(Dipl.-Ing. (FH) Andreas Hoch)

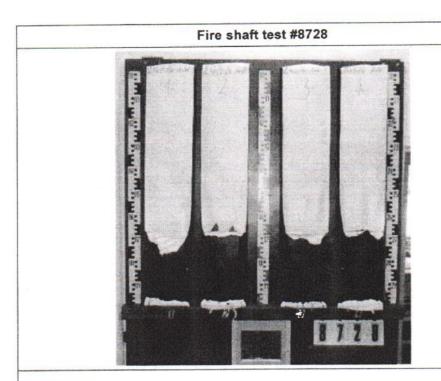

#### measurement

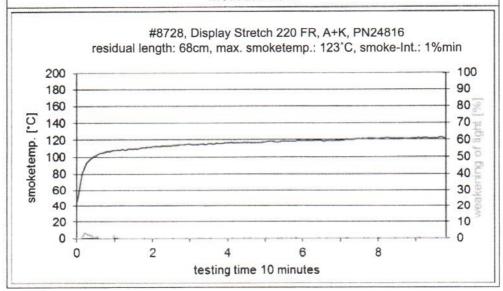


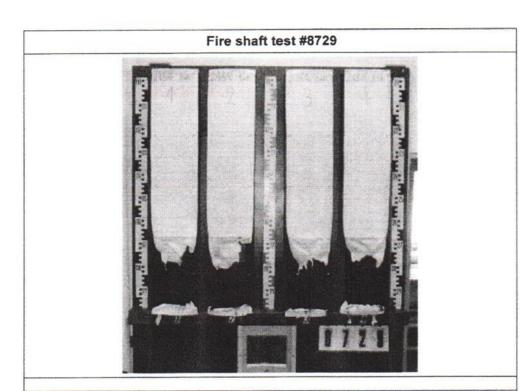


#### #8729, Display Stretch 220 FR, B+K, PN24816 residual length: 72cm, max. smoketemp.: 117°C, smoke-Int.: 1%min smoketemp. [°C] 50 0


testing time 10 minutes

measurement

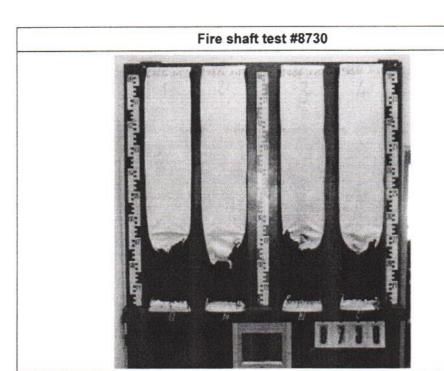

## measurement

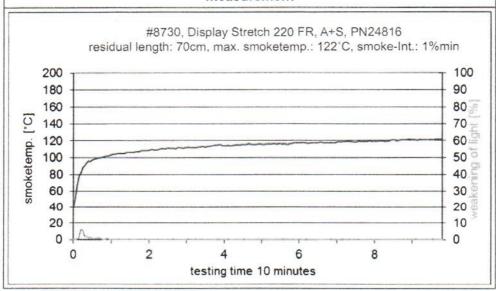

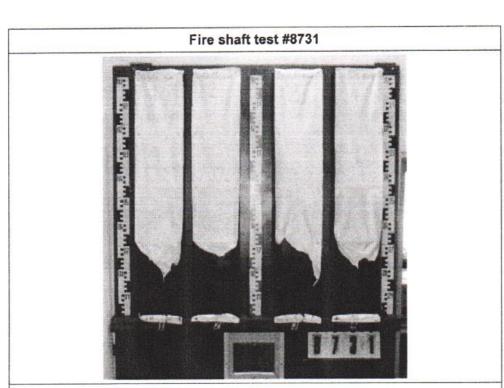

#### measurement #8731, Display Stretch 220 FR, B+K, PN24815 residual length: 71cm, max. smoketemp.: 118°C, smoke-Int.: 1%min smoketemp. [°C] testing time 10 minutes

# Test for normal flammability classifying B2 according to DIN 4102

- Description of test material in condition as delivered cf. page 2
- 2. Preparation of samples

Samples for the ignitability apparatus were cut from the sample. The samples were kept in a climate 23/50 until they reached constant weight.

3. Arrangement of samples freely suspended

Flaming side A and side B in warp and in weft direction

4. Date of test

CW 04 und CW 05 in 2017

5. Results

PN 24816: flaming side A in weft direction		•	edge	test	0.000000 100-20-		surface-test						
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	į
ignition <sup>1)</sup>	1	1	1	1	1		2		-				s
measurement mark reached1)2)	-/-	-/-	-/-	-/-	-/-		-/-						s
maximum flame height	9	7	7	8	9		4						cm
time of max. flame height	5	6	5	7	6		4				_		
Self-cessation of flames end of afterburning <sup>1)</sup>	8	7	6	8	8	-	8				-		s
flames were extinguished after1)	-/-	-/-	-/-	-/-	-/-		-/-						s
smoke development (visually)			hea	vy					he	avy			
dropping of burning material <sup>1)2)</sup>	-/-	-/-	-/-	-/-	-/-		-/-						S

PN 24816: additional tests	edge-test surface-test												
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	Ö
ignition <sup>1)</sup>	1	1	1		-		2	2	2				s
measurement mark reached <sup>1)2)</sup>	-/-	-/-	-/-				-/-	-/-	-/-				s
maximum flame height	7	7	8		-	-	7	7	4				cm
time of max. flame height	8	6	5		-		5	6	4				
Self-cessation of flames end of afterburning <sup>1)</sup>	16	-/-	8				11	10	8			-	s
flames were extinguished after1)	-/-	25	-/-				-/-	-/-	-/-				s
smoke development (visually)			hea	vy					hea	avy			
dropping of burning material <sup>1)2)</sup>	-/-	-/-	-/-				-/-	-/-	-/-			-	s

<sup>1)</sup> time denoted relative to beginning of test

<sup>2)</sup> during 20 Sec



PN 24815: additional tests	edge-test surface-test												
samples no.	1	2	3	4	5	6	1	2	3	4	5	6	Ö
ignition <sup>1)</sup>	1	1	1	1			2	2	2	2			s
measurement mark reached 1)2)	-/-	-/-	-/-	-/-			-/-	-/-	-/-	-/-			s
maximum flame height	2	3	3	3			2	2	2	2			cm
time of max. flame height	2	2	2	2		-	2	2	2	4			
Self-cessation of flames end of afterburning <sup>1)</sup>	3	3	3	3			3	3	3	5			s
flames were extinguished after1)	-/-	-/-	-/-	-/-		-	-/-	-/-	-/-	-/-			s
smoke development (visually)	moderate moderate								_				
dropping of burning material <sup>1)2)</sup>	-/-	-/-	-/-	-/-			-/-	-/-	-/-	-/-			s

<sup>1)</sup> time denoted relative to beginning of test

- 6. Remarks and explanations to the testing procedure none -
- 7. Opinion concerning the dropping of burning material

The test for normal flammability shows no dropping burning material.

<sup>2)</sup> during 20 Sec

<sup>-/-</sup> no occurrence

<sup>--</sup> no information